




# H1 Series Inverter USER MANUAL

## NO.1 Product introduction

### 1. 1 Technical Features

Items	Description
<b>Input</b> Rated voltage /frequency	3ph: 380V~440V , 50Hz/60Hz 1ph: 200V~240V , 50Hz/60Hz
Allowed voltage	3ph: 320V~460V ; 1ph: 180V~260V; voltage Imbalance rate: <3% ; frequency: ±5%
<b>Output</b> Voltage	0~rated input voltage
Frequency	0Hz~1000Hz
Overload capacity	150% rated current 60s, 180% rated current 2s
<b>Control performance</b> Control mode	V/F, SVC
Modulation Mode	SVPWM
Motor type	asynchronous motor, synchronous motor, single phase motor (consult factory before using)
Start torque	1Hz/150%
Speed range	1:100(SVC)
Frequency accuracy	digital setting: maximum frequency±0.01%; analog setting: maximum frequency±1%;
Frequency resolution	digital setting: 0.1Hz; analog setting: maximum frequency±1%;
Acceleration/ deceleration curve	line/ S-curve
Rapid current limit	limit current rapidly within the current protection value, to ensure the safety of the equipment
None-slip when instantaneous power off	none-stop when instantaneous power off, automatic frequency drop
<b>Operation function</b> Command source	keypad, terminal, communication
Set value source	digital, analog,multi-speed,communication
PID	support main setting+PID
<b>Operation panel</b> LED display	Can display: output frequency,output voltage,output current , Bus voltage, display value 1 , display value 2, error, alarm
External keypad	YES
<b>Protection function</b>	over-current protection, over-voltage protection, under-voltage protection, overheating protection, over-load protection, phase lose protection, earth leakage, etc
<b>Environment</b> Store environment	indoor, away from direct sunlight, no dust, no corrosive gas, no inflammable gas, no oil mist, no vapour, no drip and no salinity, etc
Altitude	derating use above 1000M, derating 10% per 1000M
Environment temperature	-10℃~+40℃(environment temperature around 40℃~50℃please derating use)
Humidity	5%~95%RH, no condensation
Store temperature	-40℃~+70℃
Vibration	<5.9M/S (0.6g)

### 1.2 H1 nameplate

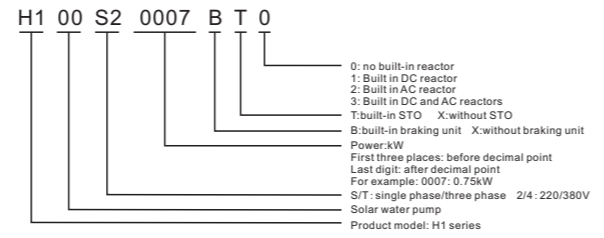

### 1.3 H1 series specifications and models


Base No.	Models	Input voltage	input current (A)	Power (kW)	output current (A)	Adaptive motor(kW)
F1	H100S20007BX0	1 phase 220V	8.2	0.75	5.0	0.75
	H100S20015BX0	1 phase 220V	14.0	1.5	7.0	1.5
F2	H100T20022BX0	1 phase 220V	23.0	2.2	12.5	2.2
	H100T20057BX0	3 phase 220V	13.5			
F3	H100T20037BX0	1 phase 220V	38.6	3.7	15.2	3.7
	H100T20055BX0	3 phase 220V	24			
F4	H100T20075BX0	3 phase 220V	37	7.5	31	7.5
	H100T20110BX0	3 phase 220V	52	11	45	11
F1	H100T40007BX0	3 phase 380V	4.0	0.75	3.0	0.75
	H100T40015BX0	3 phase 380V	5.8	1.5	4.5	1.5
F2	H100T40022BX0	3 phase 380V	6.5	2.2	5.6	2.2
	H100T40040BX0	3 phase 380V	12.6	4.0	10.5	4.0
F3	H100T40055BX0	3 phase 380V	16	5.5	14	5.5
	H100T40075BX0	3 phase 380V	21	7.5	19	7.5
F4	H100T40110BX0	3 phase 380V	28	11	26	11
	H100T40150BX0	3 phase 380V	36	15	33	15
F5	H100T40185BX0	3 phase 380V	42	18.5	40	18.5
	H100T40220BX0	3 phase 380V	48	22	46	22
F6	H100T40300BX0	3 phase 380V	62	30	58	30
	H100T40370BX0	3 phase 380V	76	37	75	37
F7	H100T40450XX0	3 phase 380V	92	45	90	45
	H100T40550XX0	3 phase 380V	113	55	110	55
F8	H100T40750XX0	3 phase 380V	157	75	150	75
	H100T40900XX0	3 phase 380V	180	90	170	90
F9	H100T41100XX0	3 phase 380V	214	110	210	110
	H100T41320XX0	3 phase 380V	256	132	250	132
	H100T41600XX0	3 phase 380V	307	160	300	160

### 2.2 Function card configuration table

Function card	H0100	H0101	H0102	H0103	H0104	H0110	H0120	H0130	H0131	H0200	H0201	H0300	H0310	H0320	H0350
Digital input	2	4	1	4	2	5	10	5	1	10	10		4	5	3
Digital output						1									
Relay output	1	1		3	1	2	2	2	1		3	3		1	1
Analog input	1	1		1	1	1	1			2	2		2	1	
Analog output						2	1	2		2	2		2	2	
Pulse input															
Pulse output															
Encoder input															
Modbus	1	1	1	1	1	1	optional	1	1		1		1	1	1
STO															
Display	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube	Digital tube
Potentiometer	Analog	Analog	Analog	Analog	Analog	Analog	Analog	Analog	Analog				Analog	Analog	
Toggle switch													1	2	2
12V power supply	1			1	1	1	1	1	1						
10V power supply				1	1	1	1	1	1						

Note:  
 1. the built-in function card with STO function must be equipped with AC drive of STO circuit, for example: H0200 built-in function card is equipped with AC drive with model H100T40040BT0 (the second T represents built-in STO circuit).  
 2. If need other types and numbers of terminals, contact the company for bulk customization

### NO.3 Product Dimension

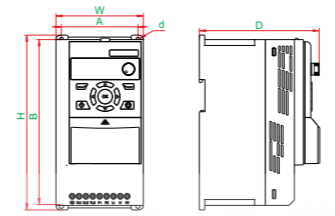

Framework	Dimensions (mm)					
	W(Width)	H(Height)	D(Depth)	A	B	d
F1	85	170	124	67.3	158	5
F2	97	194	133	85	184	5
F3	126	237	147	112	223	6
F4	168	298	160	154	283	6
F5	198	355	177	183	338	6
F6	250	400	208	230	380	7
F7	280	545	292	200	526	9
F8	380	648	299	300	626	11
F9	450	798	318	340	773	11

### NO.4 Keypad description

Item	Structure	Function description
1	Display 'F050.0'	Display
2	Program/Exit key	Program/exit
3	Status display interface work as status switch key	Status display interface work as status switch key; other interface work as left shift key
4	Reserved key	Reserved key
5	RUN key	RUN
6	Potentiometer	Potentiometer: refer to parameter P01.63
7	Value change key	In the mode of program, work as value change key; otherwise, UP/DOWN key, refer to parameter P01.63, P02.03, P02.04
8	ENTER key	ENTER
9	ENTER key	Enter
10	STOP/RESET key	STOP/RESET
11	Customization key	Customization key

### 4.2 Indicator light description

Indicator light	Status	Function description
RUN	light on / flickering	operating /decelerating
REV	light on	reverse operation
REM	light on	remote start stop
ALM	light on	fault indication
M	light on	customization indication, default alarm indication

### 4.3 Display item description

Display code	Item description
F	output frequency
C	output current
U	output voltage
d	DC bus voltage
H	display value 1(P10 98)
t	display value 2(P10 99)
A	current alarm
E	current fault

Notice: different function card corresponding to different terminals. Except standard function card, can customize any type of card. Reset parameters when using different function cards. An AC drive only can use one function card.  
**Warning: Do not use function card when power is on!**

### 2. 1 Main circuit terminal description

Terminal identification	Name	Function description
(Grounding symbol)	Grounding terminal	Safety grounding
R/L1, S/L2, T/L3	Main circuit power input terminal	Connect three phase power supply, single phase power supply connect to R/L1, S/L2
P+, PB	Braking terminal	Connect to external braking resistor
P+, P-	DC bus terminal	Two sets or more inverters use a common DC bus (Above F4 shell (including F4), with terminal P)
U, V, W	output terminal	Connect to three phase motor

## NO.5 Function · Parameter Table

Function	Function	Description (setting range)	Factory default																																																						
P00.09	Parameter operation	1.parameter initialization, initialize parameters except P00.XX in normal condition, use mode 1in initialization; 2. initialize all parameters	0																																																						
P00.10	Setting(frequency) reference F1	0: keypad P01.63	0																																																						
		1: multi-speed 2:A11 3:A12 5: communication		0: digital setting; 1: potentiometer setting;																																																					
P00.11	Setting(frequency) reference F2		0																																																						
P00.12	setting relation selection	0:F1 1:F2 2:F1+F2 3:F1-F2 4:F1*F2/100 5:maximum value(F1,F2) 6:minimum value(F1,F2) 7:average value(F1,F2) 8:PID(F1,F2)	0																																																						
		<b>* principle interpretation :</b> set 0 choose F1 channel setting value; set 1 choose F2 channel setting value; set 2 choose the sum of F1 and F2 channel setting value; set 3 choose the difference of F1 and F2 channel setting value; set 4 choose the product of F1 ans F2 channel setting value divide 100; set 5 choose larger value of F1 and F2; set 6 choose smaller value of F1 and F2; set 7 choose average value of F1 and F2; set 8 choose PID control(F1 is setting, F2 is feedback).																																																							
P00.13	maximum setting value	0.000~99999.000 <b>* principle interpretation :</b> limit setting value range.The unit of setting source is %, the maximum setting value(P00.13) stands for 100%, take maximum setting value as standard.	50.000																																																						
P00.14	motor output frequency upper limit	~1020.000Hz~1020.000Hz interpretation: motor operation frequency upper limit	55.000Hz																																																						
P00.15	multi-speed source	<table border="1"> <thead> <tr> <th>bits</th> <th>S4</th> <th>S3</th> <th>S2</th> <th>S1</th> <th>valid multi-speed</th> </tr> </thead> <tbody> <tr> <td>0-11111111</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>multi-speed 0</td> </tr> <tr> <td>units: S1</td> <td>0</td> <td>0</td> <td>1</td> <td>1</td> <td>multi-speed 1</td> </tr> <tr> <td>tens: S2</td> <td>0</td> <td>1</td> <td>0</td> <td>1</td> <td>multi-speed 2</td> </tr> <tr> <td>hundreds: digit: S3</td> <td>0</td> <td>1</td> <td>1</td> <td>1</td> <td>multi-speed 3</td> </tr> <tr> <td>thousands: digit: S4</td> <td>1</td> <td>0</td> <td>0</td> <td>1</td> <td>multi-speed 4</td> </tr> <tr> <td>...</td> <td>1</td> <td>0</td> <td>1</td> <td>1</td> <td>multi-speed 5</td> </tr> <tr> <td></td> <td>1</td> <td>1</td> <td>0</td> <td>1</td> <td>multi-speed 6</td> </tr> <tr> <td></td> <td>1</td> <td>1</td> <td>1</td> <td>1</td> <td>multi-speed 7</td> </tr> </tbody> </table>	bits	S4	S3	S2	S1	valid multi-speed	0-11111111	0	0	0	0	multi-speed 0	units: S1	0	0	1	1	multi-speed 1	tens: S2	0	1	0	1	multi-speed 2	hundreds: digit: S3	0	1	1	1	multi-speed 3	thousands: digit: S4	1	0	0	1	multi-speed 4	...	1	0	1	1	multi-speed 5		1	1	0	1	multi-speed 6		1	1	1	1	multi-speed 7	0
		bits	S4	S3	S2	S1	valid multi-speed																																																		
0-11111111	0	0	0	0	multi-speed 0																																																				
units: S1	0	0	1	1	multi-speed 1																																																				
tens: S2	0	1	0	1	multi-speed 2																																																				
hundreds: digit: S3	0	1	1	1	multi-speed 3																																																				
thousands: digit: S4	1	0	0	1	multi-speed 4																																																				
...	1	0	1	1	multi-speed 5																																																				
	1	1	0	1	multi-speed 6																																																				
	1	1	1	1	multi-speed 7																																																				
		<b>* P00.15 multi-speed source, select to corresponding external terminal, multi-speed refer to P00.16-P00.23.</b> <b>* eg select S2, S3, S4 as valid external terminal to control multi-speed</b> set P00.15=1110, detailed 8 segment corresponding relationship as above table																																																							
P00.16	multi-speed 0		0.000%																																																						
P00.17	multi-speed 1		0.000%																																																						
P00.18	multi-speed 2	~ 1000.000%~1000.000%	0.000%																																																						
P00.19	multi-speed 3	function: multi-speed setting, corresponding to P00.13 maximum setting percentage	0.000%																																																						
P00.20	multi-speed 4		0.000%																																																						
P00.21	multi-speed 5		0.000%																																																						
P00.22	multi-speed 6		0.000%																																																						
P00.23	multi-speed 7		0.000%																																																						
P00.24	acceleration time	0.050s~3600.000s <b>* principle interpretation :</b> as figure, acceleration time refer to the time from 0Hz accelerate to P00.74 motor frequency																																																							
P00.25	deceleration time		**																																																						
P00.26	Jog frequency	~ 1000.000%~1000.000% function: set jog frequency, jog command refer to P00.33	10.000%																																																						
P00.30	start command source	0: invalid	1																																																						
		1: keypad 2: communication 3: S1 4: S2 5: S3 6: S4																																																							
P00.31	reverse start command source		0																																																						
P00.32	reverse command source		0																																																						
		<b>function:</b> select command source(select keypad as command source, then reverse start command, reverse command, jog command, free stop command, safe stop command, pause command all from multi-function key of keypad)																																																							
P00.33	Jog command source		1																																																						
P00.34	stop command source		0																																																						
		<b>* reverse start command:</b> setting value reversed, and give a start command <b>* reverse command:</b> setting value reversed. <b>* jog command:</b> jog command. Priority is higher than start command, lower than stop command.																																																							
P00.35	free stop command source		0																																																						
		<table border="1"> <thead> <tr> <th>bits</th> <th>S6</th> <th>S7</th> <th>S8</th> <th>S9</th> <th>S10</th> <th>S11</th> <th>S12</th> <th>S13</th> <th>S14</th> </tr> </thead> <tbody> <tr> <td>16</td> <td>15</td> <td>14</td> <td>13</td> <td>12</td> <td>11</td> <td>10</td> <td>9</td> <td>8</td> <td>7</td> </tr> <tr> <td>S14</td> <td>S13</td> <td>S12</td> <td>S11</td> <td>S10</td> <td>S9</td> <td>S8</td> <td>S7</td> <td>S6</td> <td>invalid</td> </tr> <tr> <td>7</td> <td>6</td> <td>5</td> <td>4</td> <td>3</td> <td>2</td> <td>1</td> <td>0</td> <td></td> <td></td> </tr> <tr> <td>S5</td> <td>S4</td> <td>S3</td> <td>S2</td> <td>S1</td> <td>communication</td> <td>keypad</td> <td>invalid</td> <td></td> <td></td> </tr> </tbody> </table>		bits	S6	S7	S8	S9	S10	S11	S12	S13	S14	16	15	14	13	12	11	10	9	8	7	S14	S13	S12	S11	S10	S9	S8	S7	S6	invalid	7	6	5	4	3	2	1	0			S5	S4	S3	S2	S1	communication	keypad	invalid						
bits	S6	S7	S8	S9	S10	S11	S12	S13	S14																																																
16	15	14	13	12	11	10	9	8	7																																																
S14	S13	S12	S11	S10	S9	S8	S7	S6	invalid																																																
7	6	5	4	3	2	1	0																																																		
S5	S4	S3	S2	S1	communication	keypad	invalid																																																		
P00.36	reset command source		1																																																						

Function code	Function	Description(setting range)	Factory default															
P00.37	S1 type	<p>One place: 0: Positive logic 1: Reverse logic 2: Rising edge 3: Falling edge</p> <p>Tens place: 1: Rising edge toggle 2: Falling edge toggle</p> <p>Hundreds place: 1: The edge signal is not cleared by other edge signals Thousands place: 1: The edge signal is not cleared by the stop signal</p> <p>Function: select external terminal trigger type <b>* Principle explanation:</b> One place: 0: positive logic, High level is valid state, low level is invalid state. 1: Reverse logic, High level is invalid state, low level is valid state; 2: Rising edge, the rising edge is valid; 3: Falling edge, the falling edge is valid.</p> <p>Tens place: 1: Rising edge ping-pong key; 2: Toggle on the falling edge.</p> <p>The tens position can control the edge signal and realize a reset button to control start and stop. Hundreds place: 1: The edge signal is not cleared by other edge signals; Thousands place: 1: The edge signal is not cleared by the stop signal.</p> <p><b>*two-line mode 1:</b> the mode is most commonly used two-line mode, enable and direction combined, K1 and K2 control forward/reverse of motor</p> <div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <p>K1</p><p>K2</p><p>COM</p> </div> <div style="border: 1px solid black; padding: 5px;"> <table border="1" style="font-size: small;"> <tr> <td>K1</td> <td>K2</td> <td>operation command</td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>stop</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>reverse</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>forward</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>stop</td> </tr> </table> </div> </div>	K1	K2	operation command	OFF	OFF	stop	OFF	ON	reverse	ON	OFF	forward	ON	ON	stop	0
K1	K2	operation command																
OFF	OFF	stop																
OFF	ON	reverse																
ON	OFF	forward																
ON	ON	stop																

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.31	4	reverse start command source is S2
P00.37	0	S1 type is positive logic
P00.38	0	S2 type is negative logic

**\*two-line mode 2:**  
enable and direction separated, in this mode K1 is enable terminal, direction is controlled by K2.

K1

K2

COM

K1	K2	operation command
OFF	OFF	stop
OFF	ON	stop
ON	OFF	forward
ON	ON	reverse

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.32	4	reverse command source is S2
P00.37	0	S1 type is positive logic
P00.38	0	S2 type is positive logic

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.32	4	reverse command source is S2
P00.37	0	S1 type is positive logic
P00.38	0	S2 type is positive logic

**\*three line mode 1:**  
this mode define SB2 as enable terminal, operation command is generated by SB1 or SB3, control operation direction at the same time.  
inverter is running and SB2 is in closed state, terminal SB1 or SB3 generates a rising edge signal to control inverter operation and direction; disconnection SB2 to stop inverter.

SB1

SB2

SB3

COM

SB1	SB2	SB3	operation command
—	0	—	stop
—	1	—	forward
—	1	—	reverse

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.31	5	reverse start command source is S3
P00.34	4	stop command source is S2
P00.37	2	S1 type is rising edge
P00.38	1	S2 type is negative logic
P00.39	2	S3 type is rising edge

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.32	5	reverse command source is S3
P00.34	4	stop command source is S2
P00.37	2	S1 terminal command type is rising edge
P00.38	1	S2 terminal command type is negative logic
P00.39	0	S3 terminal command type is positive logic

**\*three line mode 2:**  
this mode define SB2 as enable terminal, operation command is generated by SB1, direction command is controlled by K. Inverter is running and SB2 is in closed state, terminal B1 generates a rising edge signal to control inverter operation, K control operation direction; disconnection SB2 to stop inverter.

SB1

SB2

K

COM

SB1	SB2	K	operation command
—	0	—	stop
—	1	OFF	forward
—	1	ON	reverse

parameter no.	setting value	description
P00.30	3	start command source is S1
P00.32	5	reverse command source is S3
P00.34	4	stop command source is S2
P00.37	2	S1 terminal command type is rising edge
P00.38	1	S2 terminal command type is negative logic
P00.39	0	S3 terminal command type is positive logic

setting value	function	description
0	always 0	Y1 terminal output always 0
1	always 1	Y1 terminal output always 1
2	stopped	in stopped status Y1 terminal output is 1
3	running	in running status Y1 terminal output is 1
4	fault	in fault status Y1 terminal output is 1
5	alarm	in alarm status Y1 terminal output is 1
6	reversing	in reversing status Y1 terminal output is 1
64	STO status	in STO status Y1 terminal output is 1
100~9999	high level parameter	

0: always 0 1: always 1 2: stopped 3: running 4: fault 5: alarm 6: reversing 64: STO status 100~9999: high level parameter  
**\* principal interpretation:**  
terminal source setting value >=100 (address mode), the address is selected parameter no., actual value is decided by current value of selected parameter no.  
terminal source function description as below:

setting value	function	description
0	always 0	Y1 terminal output always 0
1	always 1	Y1 terminal output always 1
2	stopped	in stopped status Y1 terminal output is 1
3	running	in running status Y1 terminal output is 1
4	fault	in fault status Y1 terminal output is 1
5	alarm	in alarm status Y1 terminal output is 1
6	reversing	in reversing status Y1 terminal output is 1
64	STO status	in STO status Y1 terminal output is 1
100~9999	high level parameter	

Function code	Function	Description(setting range)	Factory default
P00.41	AI1 low side voltage(current)	~99999.000~99999.000 ☉function: analog input AI1 setting *AI1 low side voltage(current): set the lowest voltage(current) of input signal. *AI1 high side voltage(current): set the highest voltage(current) of input signal.	0.000V(mA)
P00.42	AI1 high side voltage(current)	*AI1 low side setting: set corresponding value of low side voltage(current). *AI1 high side setting: set corresponding value of high side voltage(current).	10.000V(mA)
P00.43	AI1 low side setting	<i>(Graph: range setting showing AI1 high side setting and AI1 low side setting)</i>	0.000%
P00.44	AI1 high side setting	<i>(Graph: range setting showing AI1 low side setting and AI1 high side setting)</i>	100.000%

setting value	function	description
0	always 0	analog AO1 output always 0
1	always 30V/20mA	analog AO1 output always 1
2	output frequency	analog AO1 output is output frequency
3	motor current	analog AO1 output is motor current
4	output voltage	analog AO1 output is output voltage
5	motor torque	analog AO1 output is motor torque
6	output power	analog AO1 output is output power
7	setting frequency	analog AO1 output is setting frequency
100~9999	high level parameter	

0: always 0 1: always 30V/20mA 2: output frequency 3: motor current 4: output voltage 5: motor torque 6: output power 7: setting frequency 100~9999: high level parameter  
**\*\* principal interpretation:**  
AO1 signal source function description as below:

parameter no.	setting value	description
P00.46	AO1 low side setting	~99999.000~99999.000 * AO1 low side setting: set AO1 source minimum value. * AO1 high side setting: set AO1 source maximum value.
P00.47	AO1 high side setting	* AO1 low side voltage(current): set the lowest voltage(current) of output signal. * AO1 high side voltage(current): set the highest voltage(current) of output signal.
P00.48	AO1 low side voltage(current)	<i>(Graph: voltage (current) showing AO1 high side voltage (current) and AO1 low side voltage (current))</i>
P00.49	AO1 high side voltage(current)	<i>(Graph: voltage (current) showing AO1 high side voltage (current) and AO1 low side voltage (current))</i>

parameter no.	setting value	description
P00.50	PID proportional gain	0.000%~10.000% Determine the adjustment intensity of the whole PID regulator, bigger proportional gain is, bigger adjustment intensity is.
P00.51	PID integral gain	0.001s~9999.000s Determine PID regulator to the integral speed adjustment of the division of PID feedback quantity and given quantity, smaller integral gain is, greater adjustment intensity is.
P00.52	PID output upper limit	-1000.000%~1000.000% PID adjust the output maximum value, if higher than maximum value, then output PID output upper limit, relative to P0.11 maximum setting value percentage.
P00.53	PID output lower limit	-1000.000%~1000.000% PID adjust the output minimum value, if lower than minimum value, then output PID output lower limit, relative to P0.11 maximum setting value percentage.


parameter no.	setting value	description
P00.54	PID range	0.001%~9999.000% set according to actual feedback value, if lower than feedback value, then PID invalid.
P00.55	PID dormancy frequency	0.000%~500.000% set dormancy accurate frequency, relative to P0.11 maximum setting value percentage.
P00.56	PID enter dormancy time	0.000s~3600.000s inverter reach enter dormancy time and meet to dormancy time, enter dormancy.
P00.57	PID wakeup deviation	0.000%~100.000% percentage based on setting value.
P00.58	PID enter wakeup time	0.000s~3600.000s inverter reach wakeup deviation and meet to wakeup time, operation again.
P00.59	PID dormancy action	0: no dormancy; 1: PID stop; 2: decelerate to stop; 3: free stop; 4: pause; 5: operate in lowest frequency; PID enter dormancy according to setting dormancy action.

parameter	parameter name	unit	description
P01.63	keypad setting source	0	digital keypad(P02.92)setting
P02.92	keypad setting source	10	PID digital keypad set time
P00.11	feedback value	2	PID analog AI1 feedback
P00.12	setting relationship selector	8	PID enable
P00.44	AI1 high side setting	16	AI1 high side set 16kg (0~10V corresponding)
P00.50	PID proportional gain	0.01%	According to field adjustment (see PID dormancy parameter)
P00.51	PID integral gain	10s	According to field adjustment (see PID dormancy parameter)
P00.54	PID range	16	PID set feedback range 16kg
P00.55	PID dormancy frequency	10%	PID dormancy frequency set 5Hz (maximum default setting value 5Hz)
P00.56	PID dormancy time	5s	PID dormancy time 5s
P00.57	PID wakeup deviation	20%	PID wakeup deviation 20%
P00.58	PID enter wakeup time	10s	PID wakeup time 10s
P00.59	PID dormancy action	2	PID dormancy action set after dormancy, set 0: free stop; 1: decelerate
P01.68	display value 1 source	1090	keyboards display PID setting pressure
P01.69	display value 2 source	1091	keyboards display PID feedback pressure
P02.03	UPI command source	1	(UP) command from keyboard
P02.04	DOWN command source	1	(DOWN) command from keyboard

pressure sensor range: 1.6MPa(1MPa-10kg)PID control parameter

*(Graph: PID output vs time showing T1-PID enter dormancy time, T2-PID enter wakeup time, and T3-PID enter wakeup time)*

Function code	Function	Description(setting range)	Factory default
P00.60	startup function	0: start frequency operation 1: speed start 2: DC injection <b>* principle interpretation:</b> 0: no frequency output startup mode, meet to P00.61 startup time setting, P00.62 start frequency start to startup operation. 1: speed start, search rotating motor speed, smooth start without impact from search speed. 2: DC injection, inverter startup by 'DC injection before startup' mode.	0
P00.61	startup time	0.000s~60000.000s <b>* principle interpretation:</b> when system startup, setting start function work within setting start time.	0.000s
P00.62	start frequency	0.000Hz~100.000Hz <b>* principle interpretation:</b> start function finish, if setting frequency bigger than start frequency, system start from start frequency; if setting frequency smaller than start frequency, system start from start frequency.	0.000Hz
P00.63	DC injection current	0.000%~200.000% ☉function: set magnitude of DC injection current. (set P00.60*2 as DC injection) <b>* principle interpretation:</b> start mode is DC injection, need to set magnitude of DC braking current, 100% corresponding to inverter rated current.	100.000%
P00.64	stop function	units: 0: free stop; 1: DC braking; tens: 1: accurate stop <b>* principle interpretation:</b> during stop process, stop function starts work when output frequency smaller than stop frequency. accurate stop: stop at any speed motor rotation turns are same, realize consistent repeatability of stop position. To get the best efficiency, deceleration time not to trigger over pressure and over loss rate prevention function as long as possible.	0
P00.65	stop frequency	0.000Hz~1000.000Hz interpretation refer to 0.64	0.000Hz
P00.66	DC braking current	0.000%~300.000% set DC braking current.	100.000%
P00.67	DC braking time	0.000s~1000.000s set DC braking time.	0.000s
P00.68	braking resistor mode	0: invalid 1: valid function: braking resistor braking mode parameter set	1

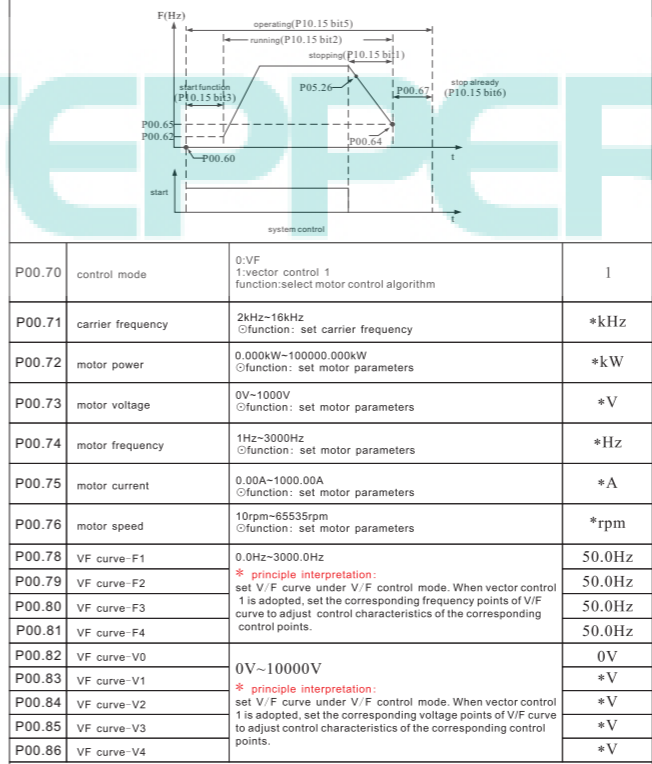

parameter no.	setting value	description
P01.41	local address	0~247 ☉function: set inverter local address
P01.42	baud rate	0: 2400bps 1: 4800bps 2: 9600bps 3: 19200bps 4: 38400bps 5~10: reserved ☉function: Communication port configuration

0: 2400bps 1: 4800bps 2: 9600bps 3: 19200bps 4: 38400bps 5~10: reserved  
☉function: Communication port configuration

Function code	Function	Description(setting range)	Factory default
P01.43	odd-even check	0: no check 1: even check 2: odd check ☉function: Communication port configuration	0
P01.44	data bits	7~8 ☉function: Communication port configuration	8bits
P01.45	stop bits	0.0~2.0 ☉function: Communication port configuration	1.0bit
P01.47	parameter decimal place mode	0~123 units: 0: remain decimal place, 1: decimal place change to 2 places, 2: decimal place change to 1 place, 3: no decimal place tens: 0: remain decimal place, 1: decimal place change to 1 place, 2: no decimal place; hundreds' digit: 0: remain decimal place, 1: no decimal place; thousands' digit: 0: remain decimal place, 1: no decimal place; tens: 0: remain decimal place, 1: decimal place change to 2 places, 2: decimal place change to 1, 3: no decimal place. hundreds' digit: 0: remain decimal place, 1: decimal place change to 1 place, 2: no decimal place. * P01.47 units aim to parameters with 3 decimal places; * P01.47 tens aim to parameters with 2 decimal places; * P01.47 hundreds' digit aim to parameters with 1 place; * P01.47 thousands' digit aim to parameters with 1 place; * P01.47 tens aim to parameters with 2 decimal places; * P01.47 hundreds' digit aim to parameters with 1 place; * P01.47 thousands' digit aim to parameters with 1 place.	0
P01.63	keyboard setting source	0: keyboard digital setting; 1: keyboard potentiometer setting; select keyboard setting value source, digit setting (P02.92) or keyboard potentiometer.	1
P02.03	(UP) command source	units: keyboard; tens: communication; hundreds' digit: S1; thousands' digit: S2; ...	0
P02.04	(DOWN) command source	units: keyboard; tens: communication; hundreds' digit: S1; thousands' digit: S2; ...	0
P10.61	history fault no. 1	—	0
P10.62	history fault no. 2	—	0
P10.63	history fault no. 3	—	0
P11.10	output frequency upon current fault	—	0.0Hz
P11.11	output current upon current fault	—	0.00A
P11.12	bus voltage upon current fault	—	0.0V
P11.13	inverter temperature upon current fault	—	0°C
P11.14	S terminal status upon current fault	—	0
P11.15	Y terminal status upon current fault	—	0
P11.16	cumulative running time upon current fault	—	0h

**NO.6 Fault code**

Fault Code	Protection function	Description
E0001	protection function	inverter components fault or software fault
E0004	ground fault	Abnormal resistance to ground, cause electric leakage
E0005	short circuit to ground	short circuit to ground
E0006	output short circuit	inverter cut off output when inverter output current is 250% larger than inverter rated current.
E0007	output over current	inverter cut off output when inverter output current is 200% larger than inverter rated current.
E0008	DC bus over voltage	inverter cut off output if main circuit DC voltage is higher than 400V(220V motor type) or 800V(380V motor type) when motor decelerates.
E0009	DC bus low voltage	input voltage decrease, inverter cut off output if main circuit DC voltage too low.
E0010	inverter over heat	inverter cut off output if cooling fin is over heat.
E0011	self-learning failure	self-learning parameter wrong or motor abnormal.
E0013	rectifier over heat	rectifier module over heat.
E0014	U phase loss	output U phase loss.
E0015	V phase loss	output V phase loss.
E0016	W phase loss	output W phase loss.
E0019	no motor connect	motor lost connection during operation.
E0020	input phase loss	power input phase loss.
E0021	inverter over load	inverter cut off output when inverter output current exceed inverter rated level (150% 60S).
E0022	over torque	motor over torque
E0024	motor over heat	motor temperature is over heat.
E0025	motor over load	inverter cut off output when inverter output current exceed motor rated level (150% 60S).
E0026	current limit	output current exceed setting limit threshold.
E0027	Input power down	The input voltage is lower than the power down standard value (P05.86)
E0033	ST0	Safe torque output stop function operation
E0034	ST1	Alarm of ST1 internal circuit diagnosis
E0035	ST2	Alarm of ST2 internal circuit diagnosis
E0036	ST3	Alarm of internal circuit diagnosis
E0063	user fault	user defined fault(P03.08)

Note: The alarm code is compared to the above table, for example: the keyboard displays "A0025" which means the motor overload alarm.